

zelsius® C5-IUF

Thermal energy meter with ultrasonic flow sensor (IUF) for heating and/or cooling systems

Optional interfaces: M-Bus, wireless M-Bus, LoRa® and 3 pulse inputs or outputs

Nominal sizes: q_p 0.6 to 10 m³/h

The zelsius® C5-IUF ultrasonic heating and cooling meter operates with an innovative ultrasonic technology, specially developed for a broad scope of application from submetering to domestic and district heating and cooling.

Specially for district heating transfer and compact apartment stations with fast temperature changes, zelsius® C5-IUF is also available as a "fast reaction heat meter" in accordance with DIN EN 1434-1.

This wear-free ultrasonic technology is stable in the long run, insensitive to dirt and measures reliably, even with very small flow volumes. The ultrasonic flow sensors can be operated permanently up to a heat medium temperature of 130°C and are optimally suited for application in district heat supply. Because of the high overload capacity and the wear-free measurement technology they can also be used to measure energy in hot water supply systems in accordance with § 9 (2) of the German heating costs ordinance.

A single button is used to call up all the important device and consumption data, such as reference date values, maximum values or the stored monthly values over the entire lifetime of the meter.

Its diverse, optionally selectable communication interfaces mean that the zelsius® C5 guarantees efficiency and precision in the recording of consumption data, whether by M-Bus or radio.



Performance characteristics at a glance

- MID type examination certificate DE-12-MI004-PTB010 in the metrological class 2
- Domestic type examination certificate DE-20-M-PTB-0046 for cooling energy metering in metrological class 2
- Flow sensor with protection class IP 68
- No straight inlet or outlet sections required
- Permanent temperature load depending on the model up to 105°C or 130°C
- Any installation position even "head down"

Technical data flow sensor IUF


| | | | | | | | |
|---|-------------------|---|-----|-----|-----|-----|-----|
| Nominal flow q_p | m ³ /h | 0.6 | 1.5 | 2.5 | 3.5 | 6 | 10 |
| Maximal flow q_s | m ³ /h | 1.2 | 3 | 5 | 7 | 12 | 20 |
| Minimum flow q_i | l/h | 6 | 15 | 25 | 35 | 60 | 100 |
| | | 12 | 30 | 50 | 70 | 120 | 200 |
| Pressure loss at q_p | bar | ≤ 0.25 | | | | | |
| Media temperature range ¹ | °C | 0 ≤ Θ_q ≤ 105 / 0 ≤ Θ_q ≤ 130 | | | | | |
| Media temperature range short-time ² | | up to 150°C for ≤ 2,000 hours | | | | | |
| Minimum pressure (to avoid cavitation) | bar | 1 bar with q_p and 80°C media temperature range | | | | | |
| Measurement accuracy class ¹ | | 2 (optional 3) | | | | | |
| Nominal pressure/ peak pressure ¹ | | | | | | | |
| ■ Body with threaded connection | PS/PN | 16/16 | | | | | |
| ■ Body with flange | PS/PN | 25/25 | | | | | |
| IP protection class | | 68 | | | | | |
| Installation position | | in any position | | | | | |
| Installation point | | return flow optionally forward flow | | | | | |
| Cable length up to calculator | m | 1.2 | | | | | |
| Installation place for temperature sensors | | M10 x 1 | | | | | |
| Heat carrier | | Water | | | | | |

¹ optional
² for versions with silicone cable temperature sensors 45 x 5.2 mm, DS 27.5, DS 38 or Universal 6 x 60 - 6 x 150



Connecting sizes¹

| Nominal flowrate L q_p (m ³ /h) | (mm) | Connection thread | Flange |
|---|------|--------------------|--------|
| 0.6 | 110 | G $\frac{3}{4}$ B | |
| 0.6 | 190 | G1B | DN20 |
| 1.5 | 110 | G $\frac{3}{4}$ B | |
| 1.5 | 190 | G1B | DN20 |
| 2.5 | 130 | G1B | |
| 2.5 | 190 | G1B | DN20 |
| 3.5 | 150 | G1 $\frac{1}{4}$ B | |
| 3.5 | 260 | G1 $\frac{1}{4}$ B | DN25 |
| 6 | 150 | G1 $\frac{1}{4}$ B | |
| 6 | 260 | G1 $\frac{1}{4}$ B | DN25 |
| 6 | 260 | G1 $\frac{1}{2}$ B | DN32 |
| 10 | 200 | G2B | |
| 10 | 300 | G2B | DN40 |


¹ optional

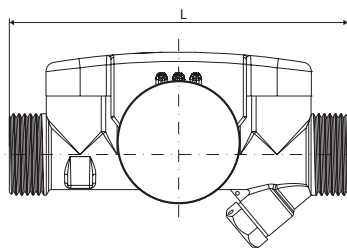

Dimensions of flow sensor with thread connection

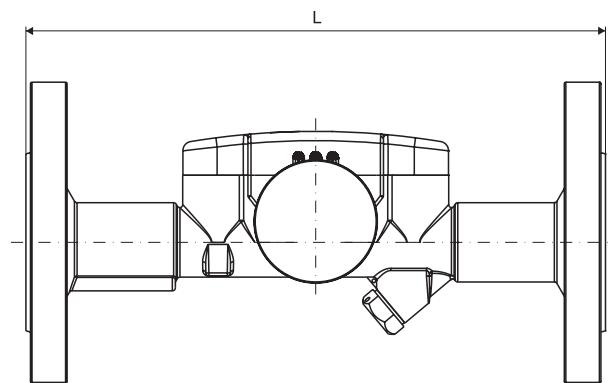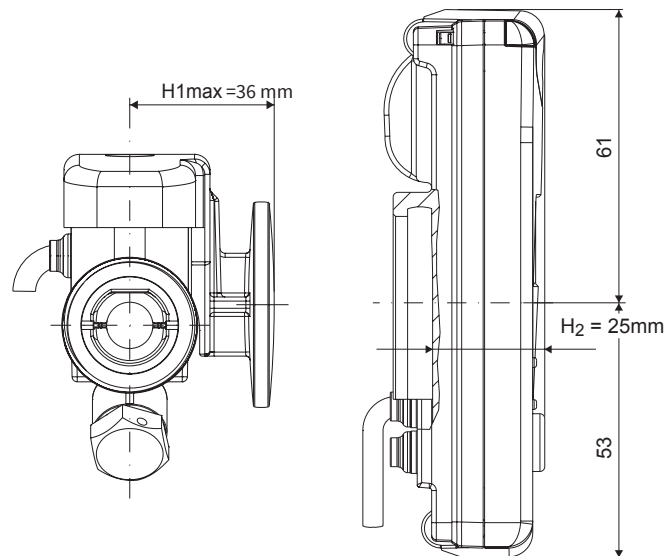

Dimensions of flow sensor with flange

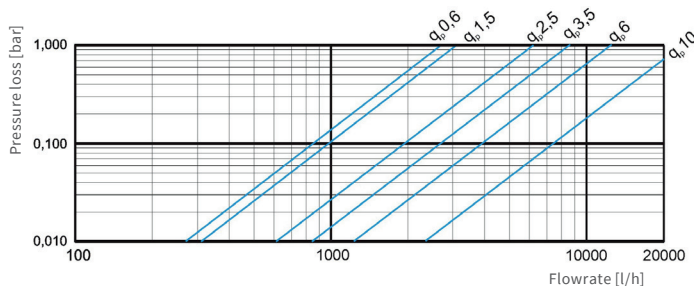

Pressure loss curve

Technical data calculator

| | | |
|---------------------------------------|----|--|
| Temperature range | °C | 0 ... 105 / 0 ... 150 |
| Temperature differential range | K | 3 ... 80 / 3 ... 130 |
| Display range | | LCD 8-digit + additional character |
| Ambient temperature during operation: | °C | 5 ... 55 |
| Storage temperature | °C | -20 ... + 65 |
| Temperature resolution | °C | 0.01 |
| Measuring intervals ¹ | s | Flowrate: 2 / 4 Temperatures: 4 / 8 / 16 / 32 |
| Unit to read the heat consumption | | Standard: MWh Optional: kWh, GJ |
| Data storage | | 1 x daily |

| | | |
|----------|--|---|
| Data log | <p>Annual due date values for heating and/or cooling energy: Storage over the whole running time for readout on the display (the last two annual reference date values can be read out via data telegram)</p> <p>Monthly values for heating and/or cooling energy as well as volumes: Storage over the whole running time for readout on the display (the last 24 monthly values can be read out via data telegram)</p> <p>Maximum values for flowrate and heating/cooling power: Storage of the absolute values since commissioning the meter as well as 12 monthly values, both with date and time</p> <p>Operation hours since commissioning the meter</p> | |
| | Standard | optical interface (ZVEI, IrDA) |
| | optional | <ul style="list-style-type: none"> - 3 pulse inputs/outputs - M-Bus (2400 baud, unlimited readout frequency, remote supply via M-Bus level converter, power consumption < 1.5 mA, transmission of consumption and instantaneous values) - wireless M-Bus (standard transmission interval 120 seconds, T1 mode with transmission of consumption and instantaneous values or 14 monthly values, also see separate description), Transmission power ≤ 25 mW - LoRa®: Daily values or monthly values (incl. half monthly values), Diagnosis protocol³, Transmission power ≤ 25 mW |
| | Power supply | 3.6 V lithium battery (different capacities) |

| | | |
|------------|----------|---|
| Interfaces | Standard | optical interface (ZVEI, IrDA) |
| | optional | <ul style="list-style-type: none"> - 3 pulse inputs/outputs - M-Bus (2400 baud, unlimited readout frequency, remote supply via M-Bus level converter, power consumption < 1.5 mA, transmission of consumption and instantaneous values) - wireless M-Bus (standard transmission interval 120 seconds, T1 mode with transmission of consumption and instantaneous values or 14 monthly values, also see separate description), Transmission power ≤ 25 mW - LoRa®: Daily values or monthly values (incl. half monthly values), Diagnosis protocol³, Transmission power ≤ 25 mW |

| | | |
|-------------------------------|-------|--|
| Battery lifetime ² | Years | > 6, opt. > 11 (changeable during the operation time) |
| Protection class | | IP54 |
| Environmental class | | A |

| | | |
|--|--------------------------|--|
| Ambient conditions / climatic influencing (valid for complete compact meter) | -climatic | Ambient temperature during operation: 5...55°C Relative humidity: < 93%, non-condensing (condensate is allowed on the outside of the flow sensor) |
| | - mech. class | M1 |
| | - electromag-netic class | E1 |

¹ optional
² The validity period for the calibration depends on the country, please observe the relevant national regulations.
³ Values for energy and volume increment as well as the average and maximum return temperature within the transmission interval (15 minutes to 1 day can be chosen) are transmitted by the meter. Values for the average supply temperature, temperature difference, thermal power and flowrate are or can be calculated by the LoRa Server based on the energy and volume increment. See also separate description.

Technical data temperature sensors


| | | |
|--------------------------------|----|--|
| Platinum precision resistor | | Pt 1000 |
| Sensor type ¹ | mm | 45 x 5.0 / 45 x 5.2 DS 27.5 / DS 38 Universal 6 x 60 - 6 x 150 |
| Temperature range ¹ | °C | 0 ... 105 / 0 ... 150 |
| Cable length | m | 1.5 (opt. 5) for q _p 0.6 to 2.5 5 for q _p 3.5 to 10 |

In the case of new installation of meters with nominal flowrates of ≤ q_p 6 m³/h and nominal pressures of ≤ PN 16 directly immersed in the heat carrier, in the case of meters with a nominal flowrate of q_p 10 m³/h also in permissible immersion sleeves. At a nominal pressure of PN 25 (usually meter with flange connection), permissible immersion sleeves are used for all nominal flowrates.

Installation point

For calibration exchange in existing measuring points with immersion sleeves with an overall length of ≤ 60 mm, please observe the separate information "Installation in existing immersion sleeves" as well as the immersion sleeve tolerance list from PTB (download at www.ptb.de).

¹ optional

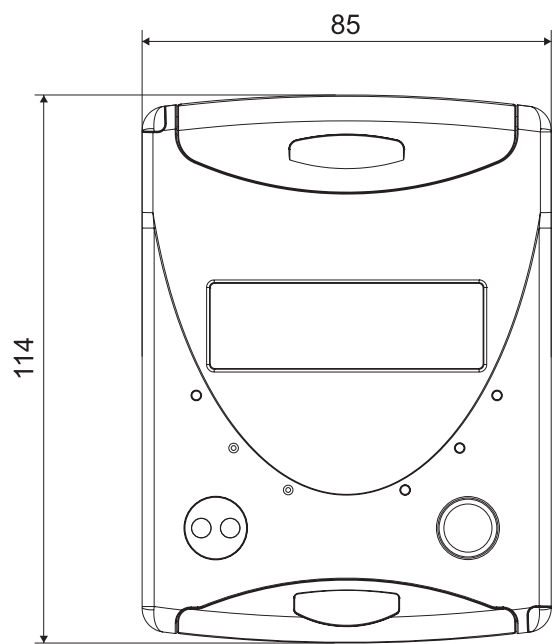

Dimensions of data calculator

zelsius® C5-IUF

Content of wireless M-Bus radio protocol with instantaneous values (type T1B)

| Example | Heat meter | Unit |
|---|------------|------|
| Medium | Heat | |
| Manufacturer | ZRI | |
| Serial number | 12345678 | |
| Version | 12 | |
| Main energy meter | 123456 | kWh |
| Main volume meter | 123456 | L |
| Energy meter (consumption) on due date | 119230 | kWh |
| Date last due date | 01.01.2019 | |
| Volume flow | 127 | l/h |
| Power | 2828 | W |
| Supply temperature | 44.3 | °C |
| Return temperature | 25.1 | °C |
| Error code | 0 | |
| Last previous month energy value | 121234 | kWh |
| Maximum average power per hour in current month | 3170 | W |

The type T1A radio protocol includes the 14 previous month's values for energy instead of instantaneous values and due date values.

Further zelsius® C5 versions:



zelsius® C5-CMF
compact meter with coaxial
measuring capsule (CMF)



zelsius® C5-ISF
compact meter with single-jet flow
sensor (ISF)

ZENNER International GmbH & Co. KG

Römerstadt 6 | 66121 Saarbrücken | Germany

Phone +49 681 99 676-30
Fax +49 681 99 676-3100

E-mail info@zenner.com
Internet www.zenner.com